


SAFE WATER ACTION PROGRAM (SWAP) REPLACING GALVANIZED PIPES

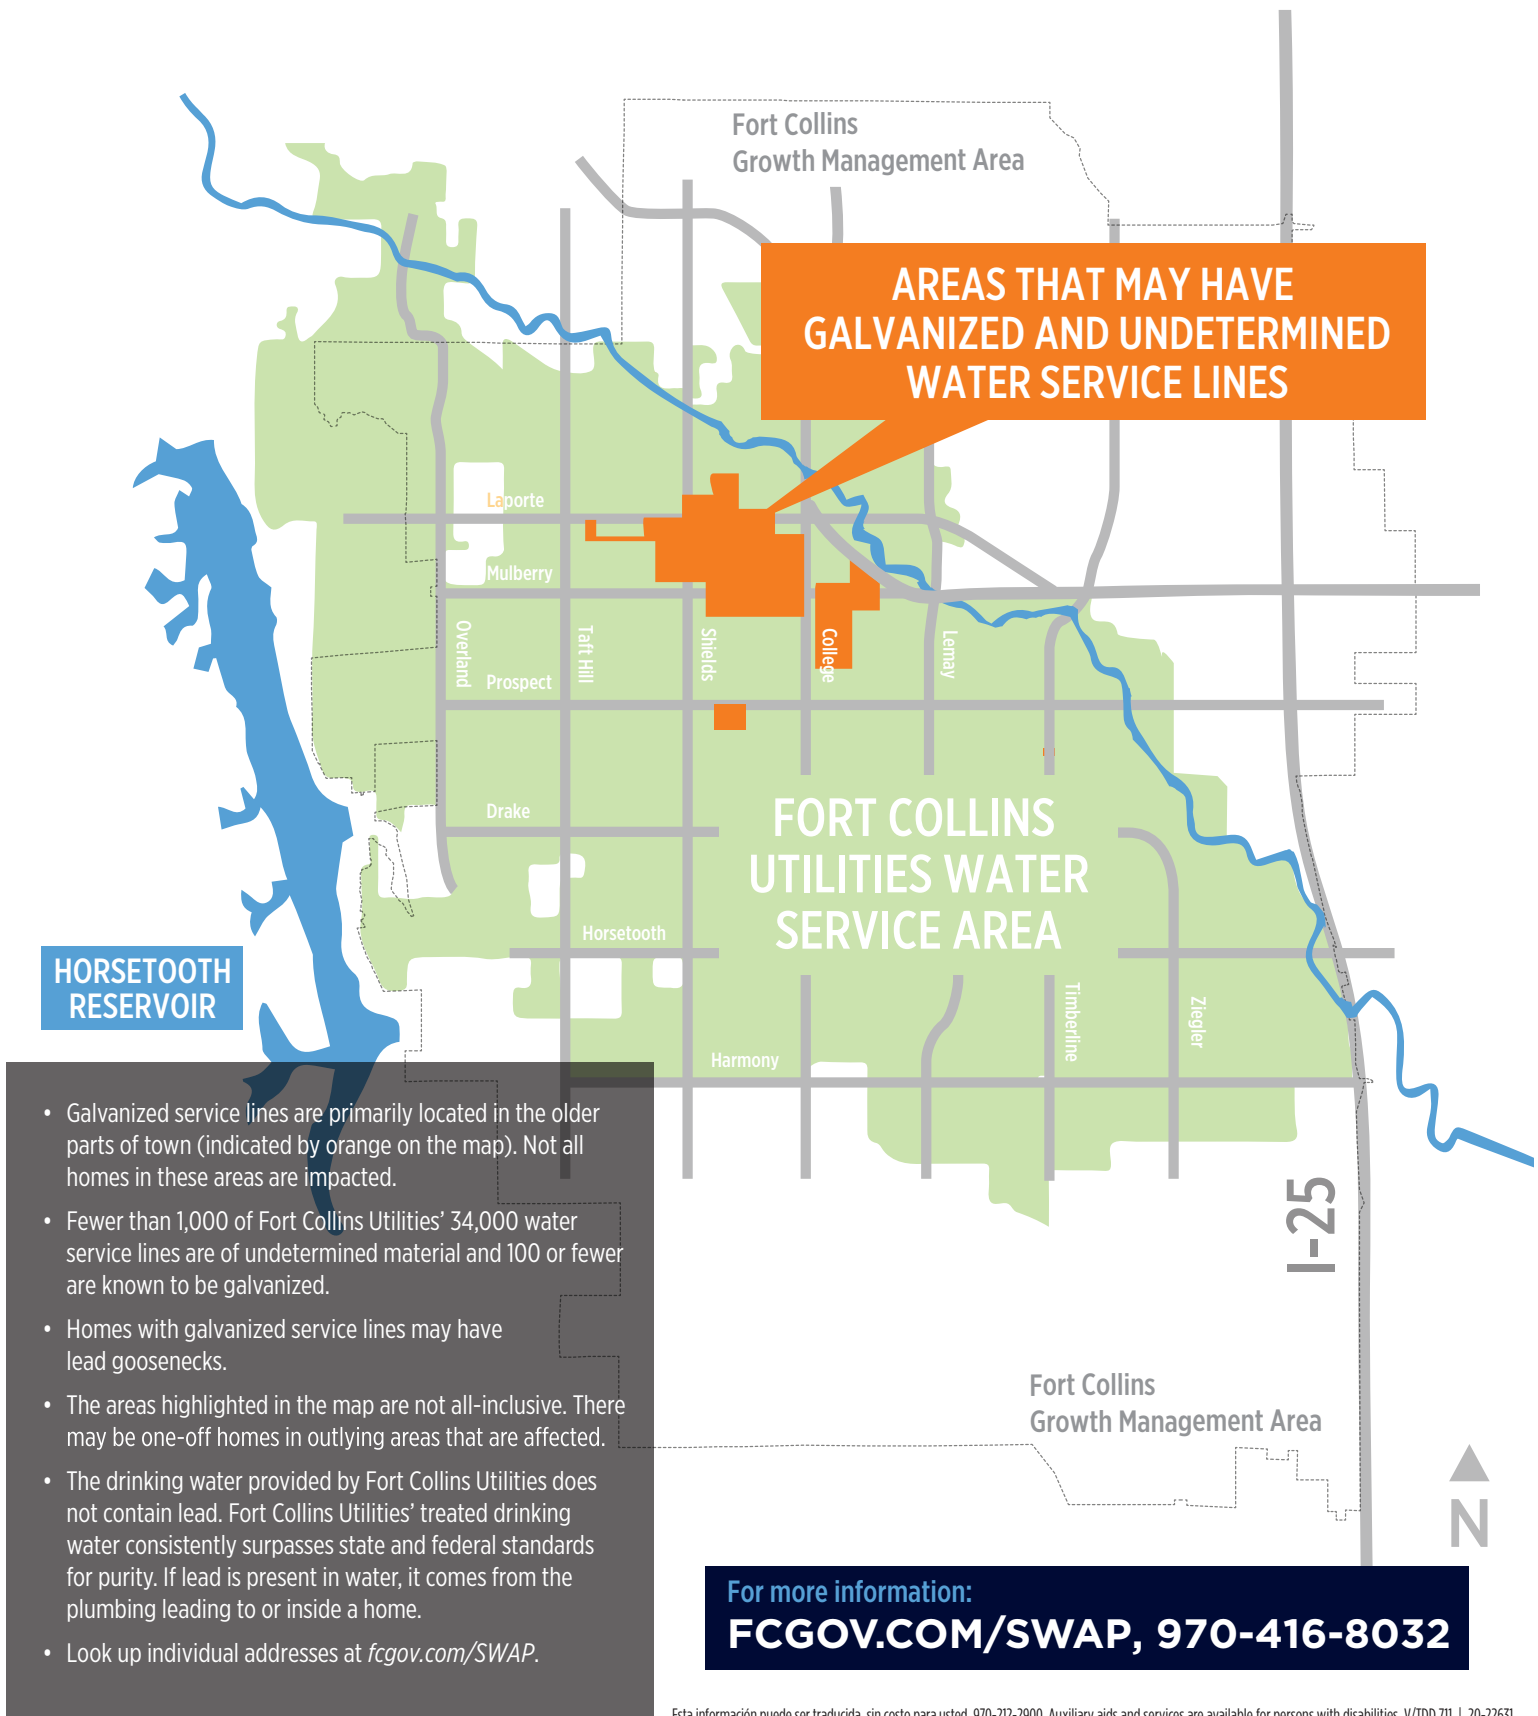

- Galvanized service lines are primarily located in the older parts of town (indicated by orange on the map). Not all homes in these areas are impacted.
- Fewer than 1,000 of Fort Collins Utilities' 34,000 water service lines are of undetermined material and 100 or fewer are known to be galvanized.
- Homes with galvanized service lines may have lead goosenecks.
- The areas highlighted in the map are not all-inclusive. There may be one-off homes in outlying areas that are affected.
- The drinking water provided by Fort Collins Utilities does not contain lead. Fort Collins Utilities' treated drinking water consistently surpasses state and federal standards for purity. If lead is present in water, it comes from the plumbing leading to or inside a home.
- Look up individual addresses at fcgov.com/SWAP.